


PLAN VIEW

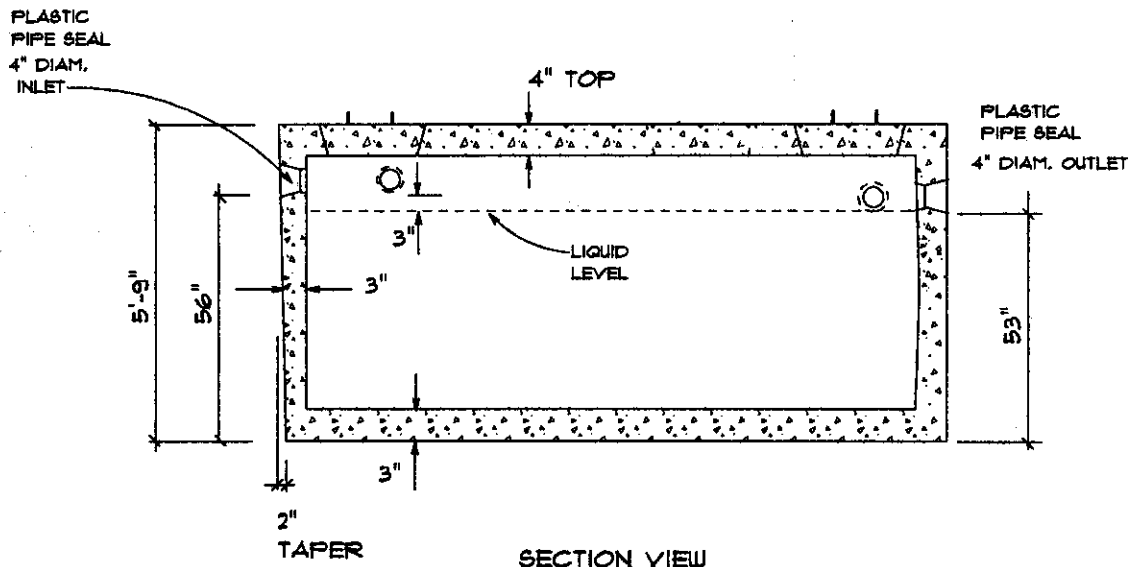

SECTION VIEW

NOTES:

1. TOP THICKNESS 4" REINF. WITH #4 REBAR @ 12" O.C. BOTH WAYS
2. BOTTOM THICKNESS 3" REINF. WITH #4 REBAR @ 12" O.C. BOTH WAYS
3. WALL THICKNESS 3" REINF. WITH 6X6 NO. 10 WELDED WIRE MESH
4. TONGUE AND GROOVE JOINT SEALED WITH BUTYL RESIN.
5. CONCRETE 4000 PSI MINIMUM AFTER 28 DAYS.
6. ALL REBAR ASTM A615 GRADE 60. 1" MIN. COVER.
7. APPROXIMATE WEIGHT IS 8,500 LBS.
8. ALL REINFORCEMENT PER ASTM C127-93.
9. MAXIMUM DEPTH OF SOIL COVER ABOVE TANK IS 3'-0"
10. DO NOT PLACE TANK WHERE IT COULD BE SUBJECTED TO EQUIPMENT OR VEHICLE LOADING.
11. ALSO AVAILABLE: THICKER TOP FOR BUOYANCY.
12. DESIGN CONFORMS WITH 310 CMR 15.00 DEP. TITLE 5 REGS. FOR SEPTIC TANKS.

WACHUSETT PRECAST, INC.

74 PRATTS JCT. RD.
P.O. BOX 501
STERLING, MA. 01564
1-800-244-7544

PHONE: 978-422-3311
FAX: 978-422-8818
EMAIL: WPRECAST@AOL.COM
WEB: WACHUSETTPRECAST.COM

1000 GALLON MONOLITHIC
SEPTIC TANK H-10

NOT TO SCALE