


PLAN VIEW

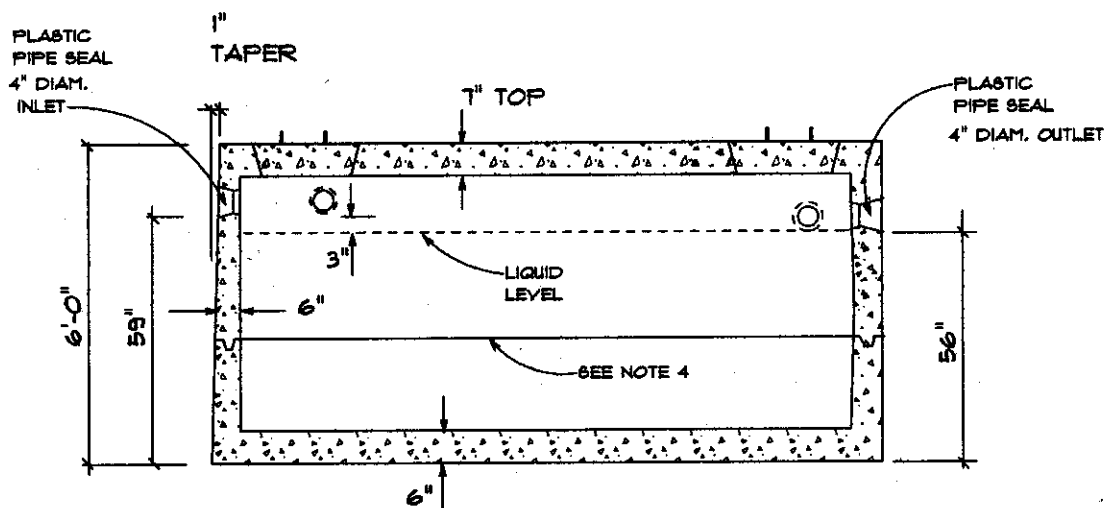

SECTION VIEW

NOTES:

1. TOP THICKNESS 7" REINF. WITH #4 REBAR @ 6" O.C. BOTH WAYS
2. BOTTOM THICKNESS 6" REINF. WITH #4 REBAR @ 6" O.C. BOTH WAYS
3. WALL THICKNESS 6" REINF. WITH 6X6 NO. 10 WELDED WIRE MESH
4. TONGUE AND GROOVE JOINT SEALED WITH BUTYL RESIN.
5. CONCRETE 4000 PSI MINIMUM AFTER 28 DAYS.
6. ALL REBAR ASTM A615 GRADE 60. 1" MIN. COVER.
7. APPROXIMATE WEIGHT IS 16,000 LBS.
8. OPTIONAL BAFFLE WALL FOR MULTI COMPARTMENT TANKS
9. MAXIMUM DEPTH OF SOIL COVER ON TANK IS 5'-0"

WACHUSETT PRECAST, INC.

74 PRATTS JCT. RD.
P.O. BOX 901
STERLING, MA. 01564
1-800-244-7544

PHONE: 978-422-3311
FAX: 978-422-8818
EMAIL: WPRECAST@AOL.COM
WEB: WACHUSETTPRECAST.COM

1000 GALLON SEPTIC TANK H-20

NOT TO SCALE