


PLAN VIEW

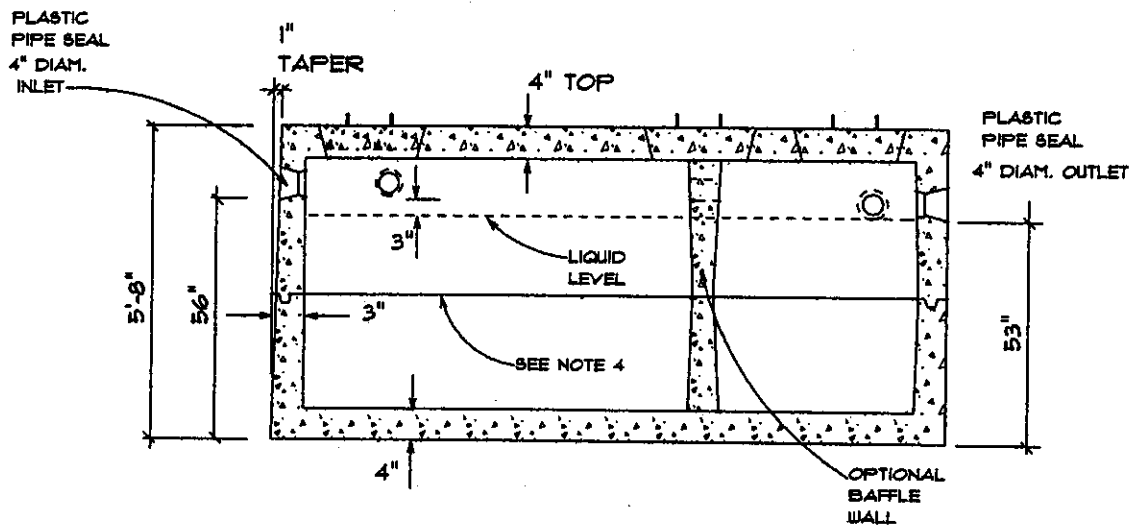

SECTION VIEW

NOTES:

1. TOP THICKNESS 4" REINF. WITH #4 REBAR @ 12" O.C. BOTH WAYS
2. BOTTOM THICKNESS 4" REINF. WITH #4 REBAR @ 12" O.C. BOTH WAYS
3. WALL THICKNESS 3" REINF. WITH #4 REBAR @ 12" O.C. BOTH WAYS
4. TONGUE AND GROOVE JOINT SEALED WITH BUTYL RESIN.
5. CONCRETE F_c 4000 PSI MINIMUM AFTER 28 DAYS.
6. ALL REBAR ASTM A615 GRADE 60, 1" MIN. COVER.
7. APPROXIMATE WEIGHT 2,000 LBS
8. OPTIONAL BAFFLE WALL FOR MULTI COMPARTMENT TANKS
9. MAXIMUM DEPTH OF SOIL COVER ABOVE TANK IS 3'-0"
10. TANK NOT DESIGNED FOR VEHICLE LOADING.

WACHUSETT PRECAST, INC.

14 PRATTS JCT. RD.
P.O. BOX 301
STERLING, MA. 01564
1-800-244-7544

PHONE: 978-422-3311
FAX: 978-422-8818
EMAIL: WPRECAST@AOL.COM
WEB: WACHUSETTPRECAST.COM

1500 GALLON SEPTIC TANK 11-10

NOT TO SCALE