



24" DIA hole
Centered IN
1000 Gallon Section

4" Outlet

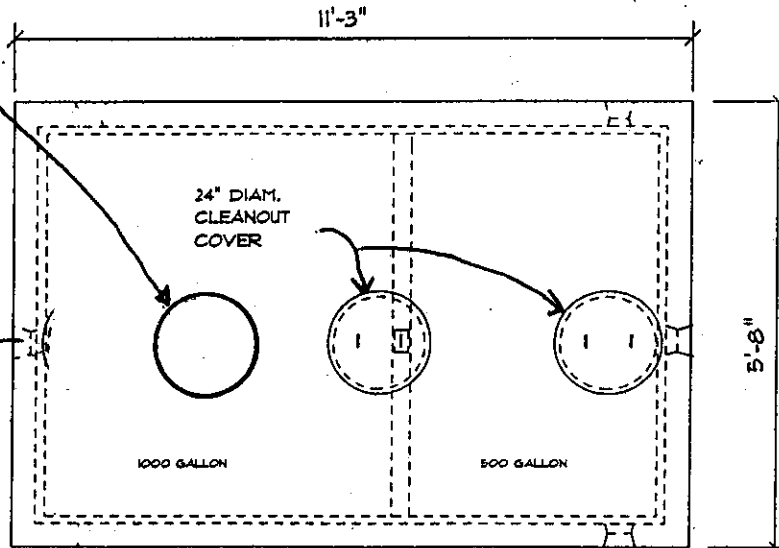

PLAN VIEW

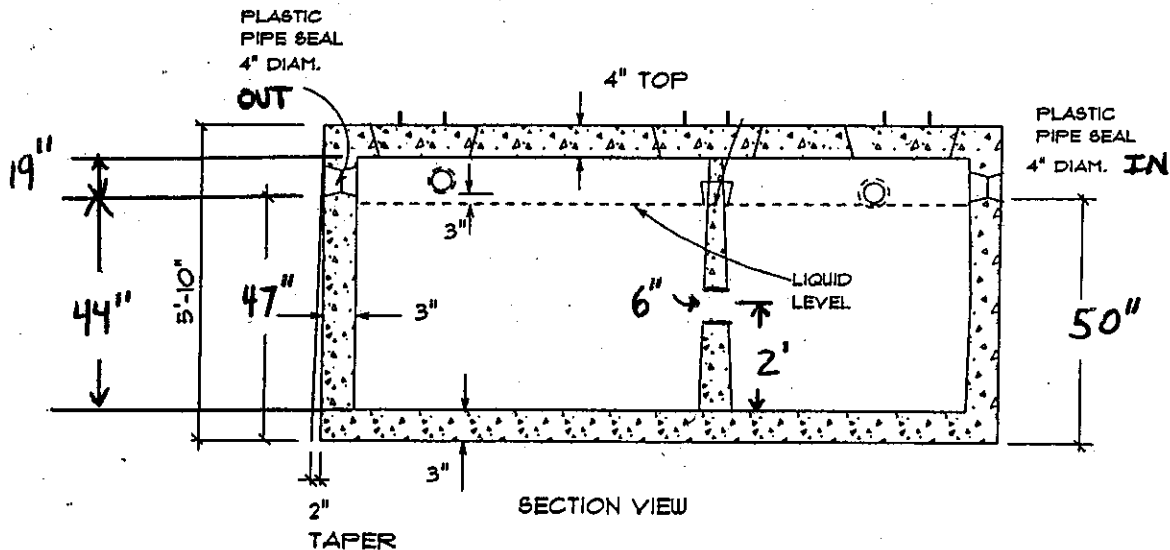

SECTION VIEW

**1500 GALLON SEPTIC TANK
MONOLITHIC 2 COMPARTMENT H-10
(FAST TANK)**

NOTES:

1. TOP THICKNESS 4" REINF. WITH #4 REBAR @ 12" O.C. BOTH WAYS
 2. BOTTOM THICKNESS 3" REINF. WITH #4 REBAR @ 12" O.C. BOTH WAYS
 3. WALL THICKNESS 3" REINF. WITH 6X6 NO. 10 WELDED WIRE MESH
 4. TONGUE AND GROOVE JOINT SEALED WITH BUTYL RESIN.
 5. CONCRETE 4000 PSI MINIMUM AFTER 28 DAYS.
 6. ALL REBAR ASTM A615 GRADE 60, 1" MIN. COVER.
 7. APPROXIMATE WEIGHT 12,500 LBS
 8. ALSO AVAILABLE, THICKER TOP FOR BUOYANCY
 9. DESIGN CONFORMS WITH 310 CMR 15.00, DEP TITLE 5 REGS. FOR SEPTIC TANKS
 10. ALL REINFORCEMENT PER ASTM C1221-93
- STRUCTURAL NOTES:
11. MAXIMUM DEPTH OF SOIL COVER ABOVE TANK IS 3'-0"
 12. DO NOT PLACE TANK WHERE IT COULD BE SUBJECTED TO EQUIPMENT OR VEHICLE LOADING.

WACHUSETT PRECAST, INC.

14 PRATTS JCT. RD.
P.O. BOX 301
STERLING, MA. 01564
1-800-244-7544

PHONE: 978-422-3311
FAX: 978-422-8818
EMAIL: WPRECAST@AOL.COM
WEB: WACHUSETTPRECAST.COM

1500 GALLON SEPTIC TANK
MONOLITHIC 2 COMPARTMENT H-10

FAST TANK

NOT TO SCALE